



MINIMUM DISTANCES

Minimum distance to flammable materials

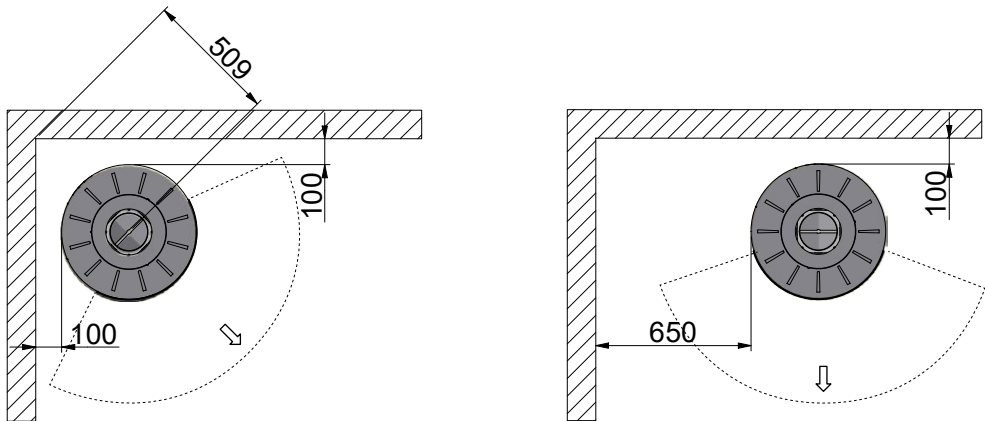

Minimum distance to flammable wall protected by a fire wall

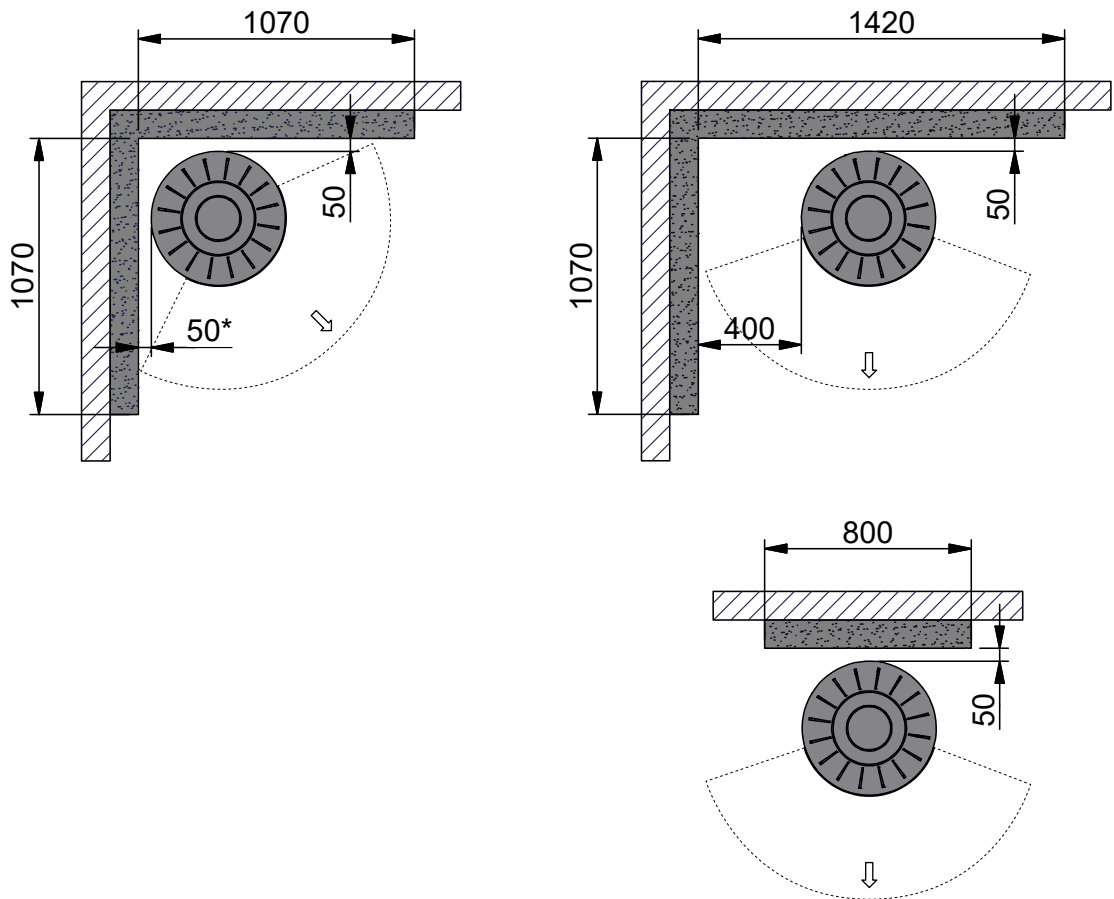

-  Flammable material
-  Fire wall, e.g. 50 mm Jøtul Firewall, 110 mm brick or other material with corresponding fireproof and insulating abilities

All distances are in mm.
All distances are minimum distances
These distances apply for an insulated flue pipe, all the way down to the stove
(The requirements to the chimney and the flue pipe in terms of safety distances must be met)
* In order for the door to open, the distance must be 100 mm on the left side