

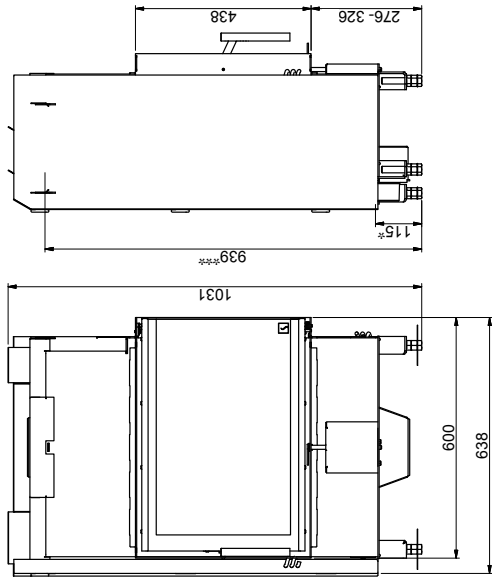


DIMENSION SKETCH AND MINIMUM DISTANCES


Dimensional drawing scan 5003 with heat shield to fire wall (Accessory)

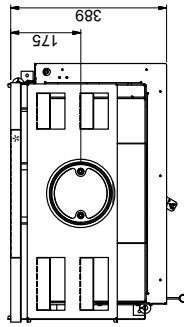

Scan 5003

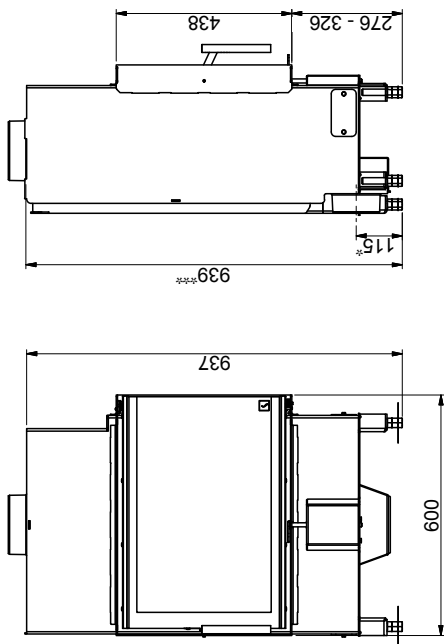

Floor plate

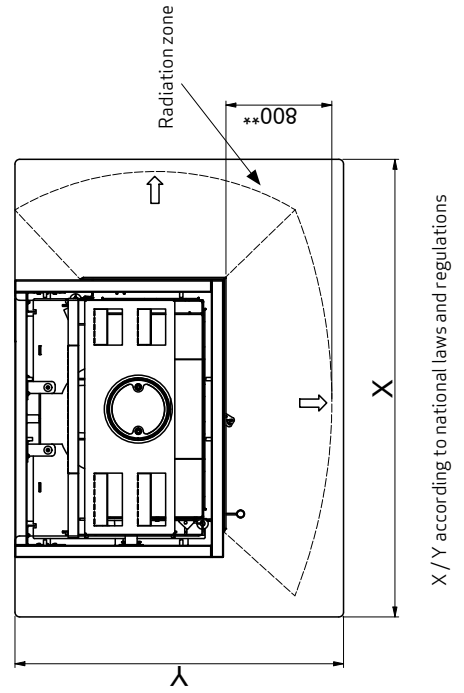

Flammable material

All distances are in mm.

All distances are minimum distances

* Connection of fresh-air intake - inside measure: Ø 103 mm - outside measure: Ø 120 mm

** Min. distance to furniture/flammable material

*** Height to the beginning of flue connecting piece at top/rear outlet.

flue conn. piece - inside measure: Ø 132 mm - outside measure: Ø 149 mm